

Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.

If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH

Im Gewerbegebiet 1

DE-73116 Wäschenbeuren

+49 (0) 7172-92666-0

info@process-informatik.de

<https://www.process-informatik.de>

Menutree Website:

+ Products / docu / downloads

+ Micro-SD-card 32GB




QR-Code Website:




Please make sure to update your drivers before using our products.

Data backup S5-PLC on SD-card




S5-PLC triggered DB-backup/-restore without additional PC via PG-socket and Ethernet on SD-card

Visualisation of your S7- PLC via COM-Port

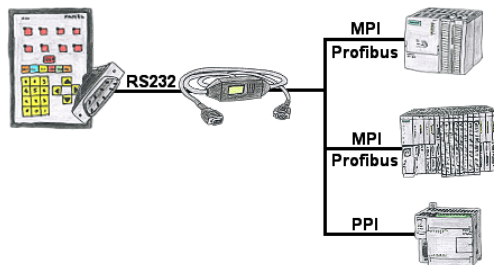


Your panel provides a serial port and no MPI/Profibus for connecting a S7-PLC. Connect the MPI/PPI-cable with it and you're Online with your panel.

Actual time for the PLC?

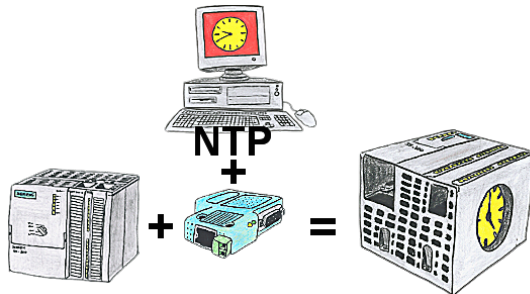

You need in your PLC a actual time? No problem, with the NTP-function the S7-LAN-module get from a NTP-(Time-)Server the actual time and transfers it direct into the configured PLC or for processing in a DB.

Occupied programming interface => does not have to be

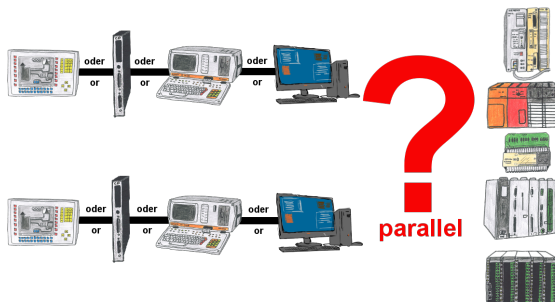

Your Programming-interface of the PLC is already occupied with a panel or PC or communication-processor?

You should accomplish program modifications without removing the other communication-partner? You connect the PLC-specific Multiplexer one-time to the PLC and then connect the communication-partner and also your PC. Now you can work parallel with the PLC without the need of affecting the operation/communication of the panel/CP.

You can even work with 2 programming devices simultaneously, 2x open the same block, only changes which are stored at last will be finally stored in the PLC. Also ideal for trainings purposes if PLC's with IO's are scare goods.

Multiplexer-devices of the PG-MUX-II-family are the ultimate service-device, regardless of what you plug into the two PG-sockets, both participants communicate parallel with the controller.

S7-PLC over RS232




Communication with S7-PLC via RS232 (COM-port), just how and with what?

Data-communication with S7-PLC from PC or other devices via RS232, which interface is required. Questions you don't have to worry about. With "S7 over RS232" you get the right interface-products for PPI, MPI and Profibus.

Which one you use then is up to you.

Simple and uncomplicated remote maintenance

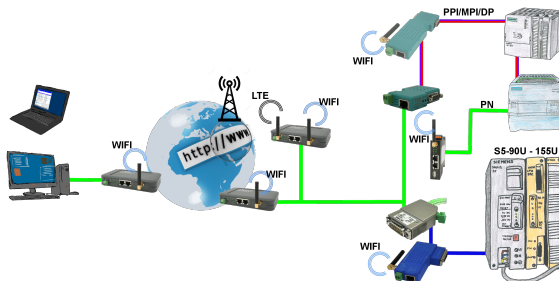

Simple and uncomplicated remote-access to your devices/systems via the Internet

VPN-tunnel, registration at any portal is not necessary, activate the device and select and communicate with the opposite system

No great effort to implement access. Use of the devices without consulting IT, no time-consuming commissioning procedure

All your devices in your own cloud, no access from third-party CONNECT-devices to your devices/systems